

Operations Guide - GreaseShield® 1850-F

FilterShield™ 2000


Solids are collected and de-watered in the removable FilterShield basket. The basket must be emptied regularly and cleaned at least once a day. Please ensure a basket is always in place during normal operation.

More information about the FilterShield™ 2000 can be found on page 2 of this document.



Normal Operational Times

GreaseShield®
PATENT No. GB2497334



The standard operation times for a GreaseShield®1850 is from 07:00 hrs until 02:30 hrs.

Grease Removal - 5 minutes on followed by 5 minutes off for the duration of the operational period.

Cleaning - Once a day, at the start of operation.

(These operation times can be adjusted upon request.)

Automated Self Cleaning

Upon activation clean hot water is added into the GreaseShield®, via a WRAS approved water solenoid valve. The Combination of this with the pulsing action of the Grey Water Recirculation pump, agitates and circulates the effluent preventing build of fine sediments in the tank.

(Additional cleaning cycles can be added upon request)



FOG Container

The extracted FOGs are collected in the FOG storage container. This container must be emptied and cleaned at least once a day including the wiper blade. The Max Fill Line should not be exceeded.

Service Function




The Manual Service button activates a Pump to lower the water level of the unit for servicing. Grey water is extracted from the bottom of the tank and sent directly to the drain via the grey flexible hose on the back.

(Service permitted only by trained and authorised personnel)



Magnetic Baffle

Magnetically treats the effluent to help create an in-situ Bioremediation effect. This effect helps prevent the build-up of scaling in pipework by calcium and metal deposits.

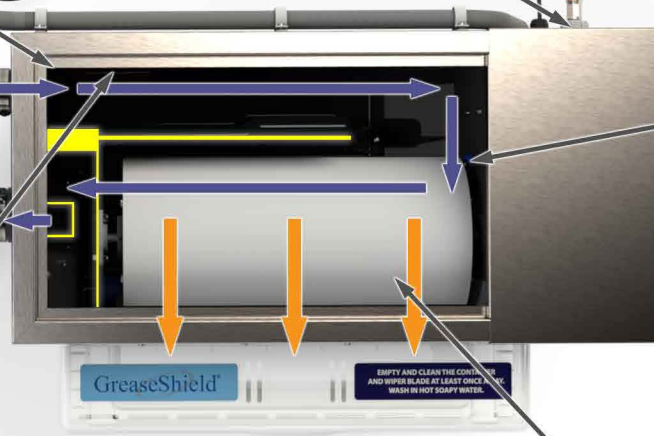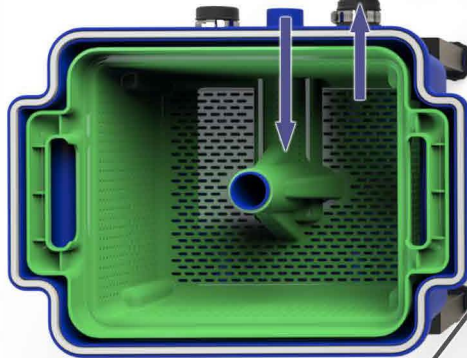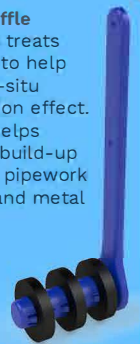

Grey Water Recirculation

During operational hours when FOG removal takes place, waste thermal water is recirculated from the outlet of the GreaseShield®1850 back to the Inlet. This encourages the reverse flow of effluent and ensures that FOGs are directed towards the FOG Removal Roller.


FOG Removal

A number of co-operating baffles combined with the reverse flow design of the tank, utilises the difference density of grey water and FOGs to separate the effluent. FOGs are directed towards a large, oleophilic (attracts FOGs) and hydrophobic (repels water), FOG Removal Roller. This submerged Roller removes the FOGs from the effluent. A silicone Wiper Blade, with anti-static properties, scrapes the FOGs from the roller and deposits them into the FOG Container.

Operations Guide - GreaseShield® 1850-F



Quick Release Lid
The FilterShield™'s 2000 Lid simply clips in place and is quick to remove. The silicone seal creates a water tight fit to stop any liquid splashes or odours escaping from it.

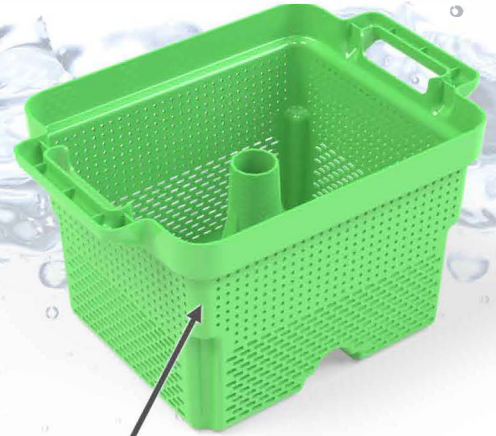


Filter Basket
The filter basket collects any solid contaminants that pass through the arterial drainage line. The perforated design allows liquids to pass through and de-waters any solids that are collected. The basket is easy to remove and clean.

Adjustable Hygiene Stand (Optional Extra)
Stainless Steel stand with adjustable self levelling feet. Raises the height of the FilterShield™2000 by 260mm (10.2") to allow easy access for cleaning. The FilterShield™ bolts onto the stand for added stability.

Self Levelling Adjustable Feet
The FilterShield™2000 is supplied with self levelling adjustable feet. These feet can raise the height of the FilterShield™2000 by up to 120mm (4.7")



Dual Outlet Tank
The FilterShield™2000 features a dual outlet design that allows the user to choose which outlet to use depending on the orientation of pre-existing plumbing and equipment.

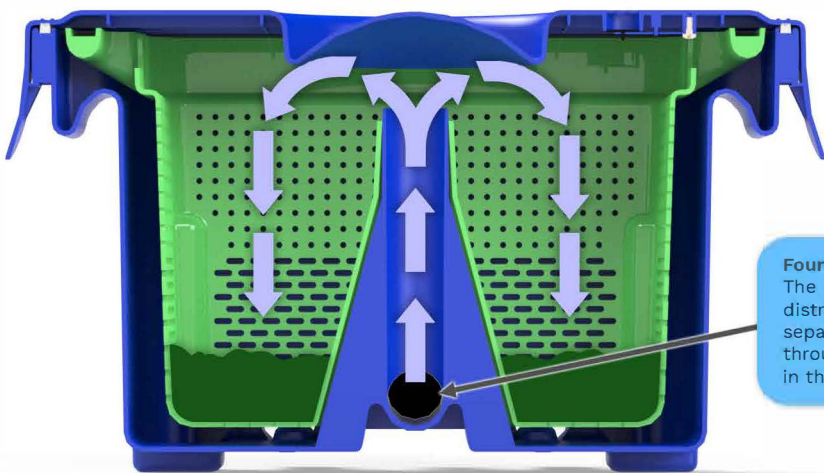

Fountain Inlet
The unique fountain inlet design helps to control the flow and distribute it within the filter basket. This assists with the solid separation and de-watering processes. The liquid effluent passes through the perforated holes and the solid contaminants are retained in the basket.



Aqua Mundus

V1 03/04/2020